

**SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE**


No. 11/LAB

Dated: 27/02/25

It is certified that an inspection team headed by **Mr. Praveen Sharma**  
(Name of Officers with designation) from **Assistant Engineer, Sub Division, PHED Indore (MP)**  
inspected the **Delhi International School at Jawahar Takeri, Dhar Road, Indore (MP)** on  
**24/02/2025** (date of inspection) and on the basis of Water Test Report (Attached) bearing no  
2025/DW/040 dated 27/02/2025 of **Water Testing Laboratory, Indore (PHED Lab)** certified that  
the **Delhi International School** has safe drinking water facilities for the students and members of  
staff of the institution. School is also maintains the hygienic sanitation condition in the school  
building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.

This certificate is valid till 01 Year

To  
**Delhi International School**  
**Jawahar Takeri, Dhar Road**  
**Indore (MP)**

  
**Assistant Engineer**  
**Maint. Sub Dn. No. 8;**  
**PHE, INDORE (M.P.)**

# Water Testing Laboratory

## Indore Municipal Corporation, Musakhedi, Indore

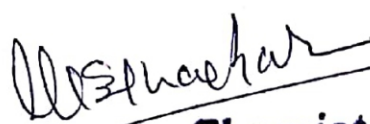
### Test Certificate

<b>Sample from</b> Delhi International School, <b>Jawahar Takeri , Dhar Road</b> <b>Indore</b> <b>Sample Details</b> 1ltr Bottle by your self	Report No:2025/DW/040
	Date of Collection :24/02/25
	Date of Receipt : 24/02/25
	Completion date : 27/02/25
	Time of Receipt :

S.No.	Tests	Units	Desirable Limit IS-10500-12	Permissible Limit IS-10500-12	Results
<b>A.</b>	<b>Organoleptic and Physical Parameters</b>				
1.	Temperature	°C	----	----	25.6
2.	Colour	Platinum Cobalt Scale	5	15	0
3.	Odour		Agreeable	Agreeable	agreeable
4.	Turbidity	N.T.U.	1	5	0.5
5.	Total Dissolved Solids	mg/l	500	2000	33
<b>B.</b>	<b>General Parameters Concerning Substances Undesirable in Excessive Amounts</b>				
6	pH	pH scale	6.5-8.5	No Relaxation	7.44
7.	Alkalinity	mg/l	200	600	24
8.	Total Hardness	mg/l	300	600	32
9.	Chloride	mg/l	250	1000	6
10.	Fluoride	mg/l	1.0	1.5	0.1
11.	Iron	mg/l	0.3	1.0	BDL
12.	Calcium	mg/l	75	200	1.2
13.	Magnesium	mg/l	30	100	4.8
14.	Sulphate	mg/l	200	400	4.2
15.	Nitrate	mg/l	45	No Relaxation	0.5
<b>C.</b>	<b>Coliform Count</b>				
19.	Thermotolerant Coliform bacteria	CFU/100ml	0	0	0

'BDL ' Below determination limit

**Remark:-** Tested parameter confirms desirable limit hence safe for drinking.

  
**Incharge Chemist**  
 M.P. No. 2 PHE/IMC  
 AUTHORIZED SIGNATORY (IM)  
**INDORE (M.P.)**

